


Maintaining Normal Body Temperature – Negative Feedback
Set Point 37 °C



Maintaining Normal Body Temperature – Negative Feedback
Set Point 37 °C

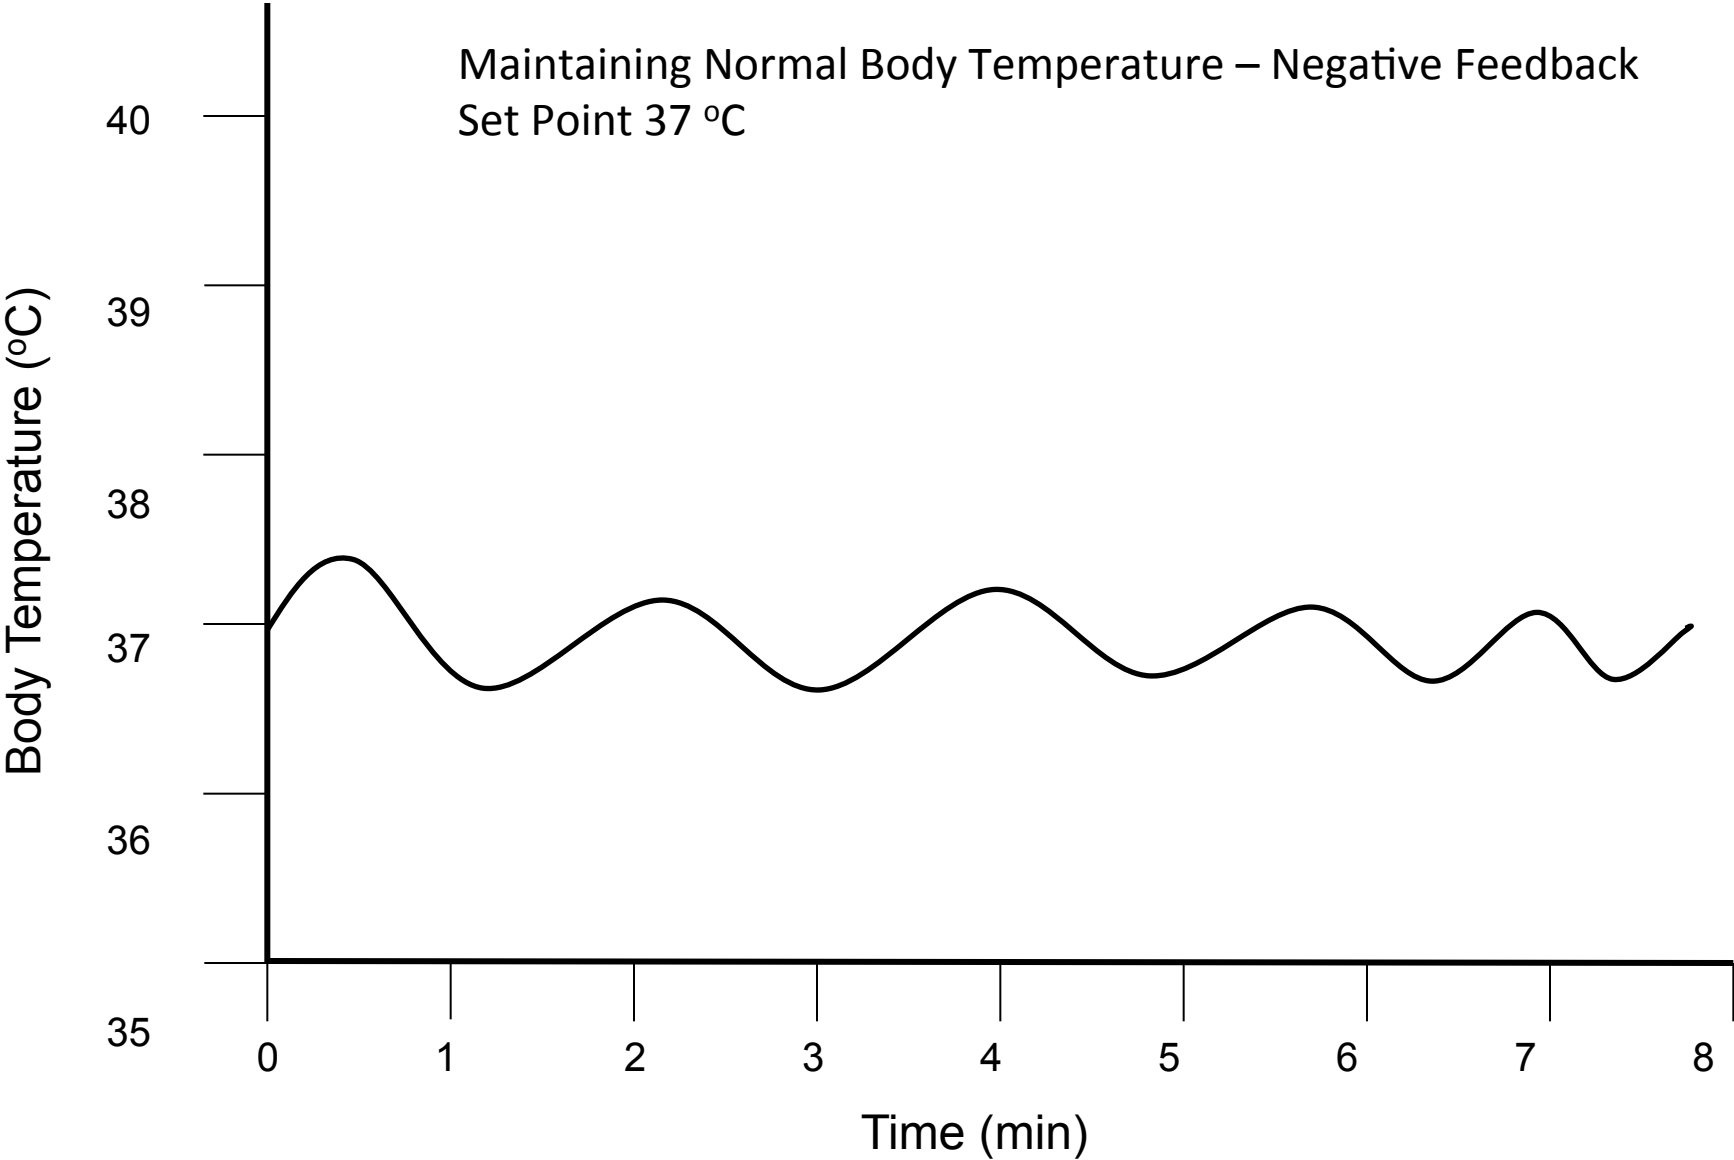